



WILPINJONG COAL PTY LTD

Environment Protection Licence (EPL) 12425

[Link to Environment Protection Licence EPL12425](#)

**LICENCE MONITORING DATA
MONTHLY SUMMARY REPORT**

for

1 December 2020 to 31 December 2020

Air Monitoring

Air quality surrounding the Wilpinjong Coal Mine is monitored using:

1. tapered element oscillating microbalances (TEOM);
2. high volume air samplers (HV); and
3. dust deposition gauges (DG).

In terms of the above equipment:

1. the TEOM and HVAS measure fine dust particles up to 10 microns in diameter (i.e. PM10); and
2. the DG measure the total dust deposited in the gauge during the sample period.

All are influenced by mining as well as non-mining activities in the local area.

The location of the above monitoring equipment in relation to Wilpinjong Coal Mine is shown in **Figures 6** and **8**.

A summary of the monitoring results for the month is provided in **Table 1** and the yearly trends are also shown in **Figures 1** to **3**.

For comparison with **Figures 2** and **3**, **Figure 4** displays the Regional 24Hr PM10 Average. PM10 dust levels for the month have been recorded in Bathurst and Merriwa by NSW EPA.


Table 1 - Air Monitoring

EPL ID No.	Monitoring Point ID.	Pollutant	Unit of Measure	Monitoring Frequency required by EPL	No. of times measured during month	Min. Value	Max. Value	Mean Value	Measurement	Annual Average	Limit	Exceed* (yes/no)	Date Last Sampled	Date Reported
3	DG4	Particulates - TIM	grams per square metre per month	Monthly	1				2.1				23/12/20	27/01/20
4	DG5	Particulates - TIM	grams per square metre per month	Monthly	1				1.5	1.9	4.0	No	23/12/20	27/01/20
6	DG8	Particulates - TIM	grams per square metre per month	Monthly	1				2.7				23/12/20	27/01/20
9	DG11	Particulates - TIM	grams per square metre per month	Monthly	1				2.4				23/12/20	27/01/20
17	DG15	Particulates - TIM	grams per square metre per month	Monthly	1				2.0				23/12/20	27/01/20
13	HV1	PM10	micrograms per cubic metre	Every 6 days	5	7.2	23.0	14.2			50	No	28/12/20	27/01/21
19	HV4	PM10	micrograms per cubic metre	Every 6 days	5	9.1	26.2	16.5			50		28/12/20	27/01/21
20	HV5	PM10	micrograms per cubic metre	Every 6 days	5	5.9	31.2	16.8			50		28/12/20	27/01/21
22	TEOM3	PM10	micrograms per cubic metre	Continuous (24 Hr Average)	96.8%	2.5	19.4	9.4			50	No		
23	TEOM4	PM10	micrograms per cubic metre	Continuous (24 Hr Average)	100.0%	3.7	41.3	16.2			50			

Notes:

- Limits specified in the above table are from Development Consent SSD-6764.

Figure 1a. DG Results - 12 Month Trend

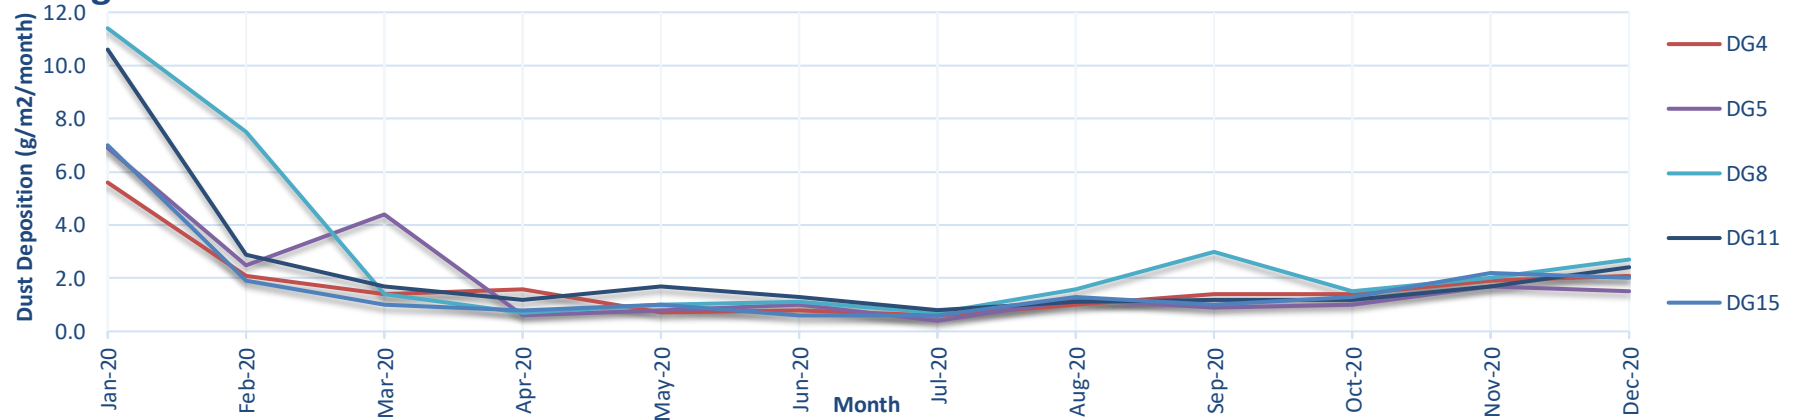

Notes:

1. Limit of 4 g/m²/month (annual average) applies to DG5 (Wollar Village) - refer Figure 1b.
2. During January 2020, all dust gauges recorded an ash content higher than 80% due to the regional bushfires.
3. In March 2020, DG5 contained high concentrations of both ash and organic matter. The excessive result can be linked to lawn mowing occurring near the dust gauge during the month.

Figure 1b. DG 5 Results - Annual Average


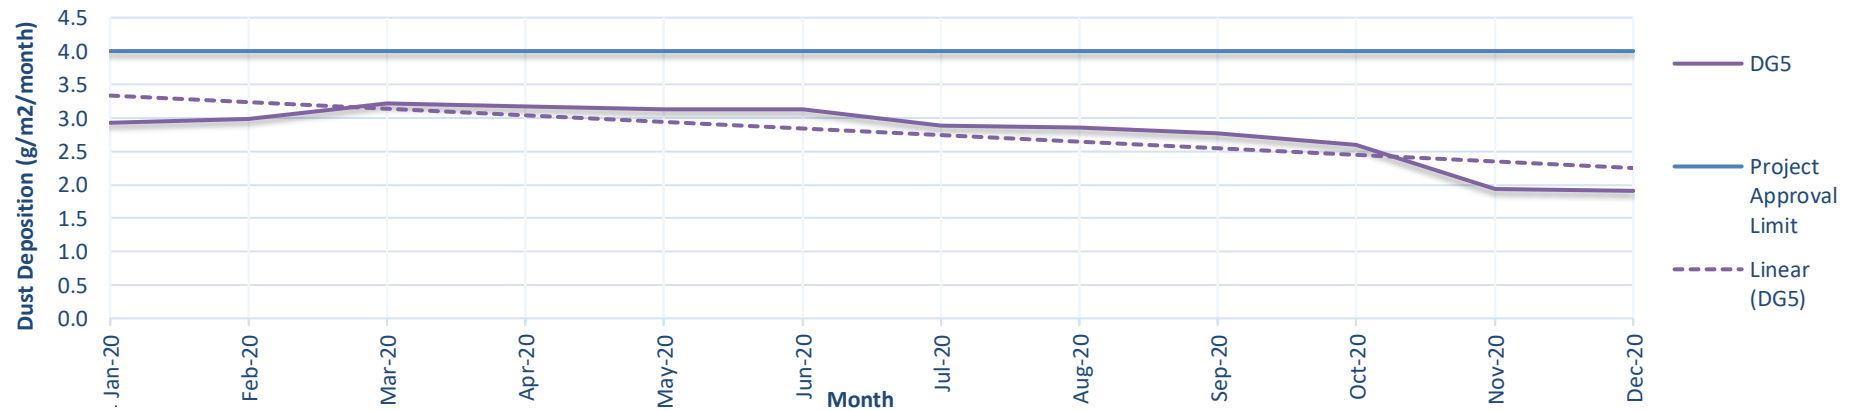


Figure 2. HV (PM10) Results - 12 Month Trend

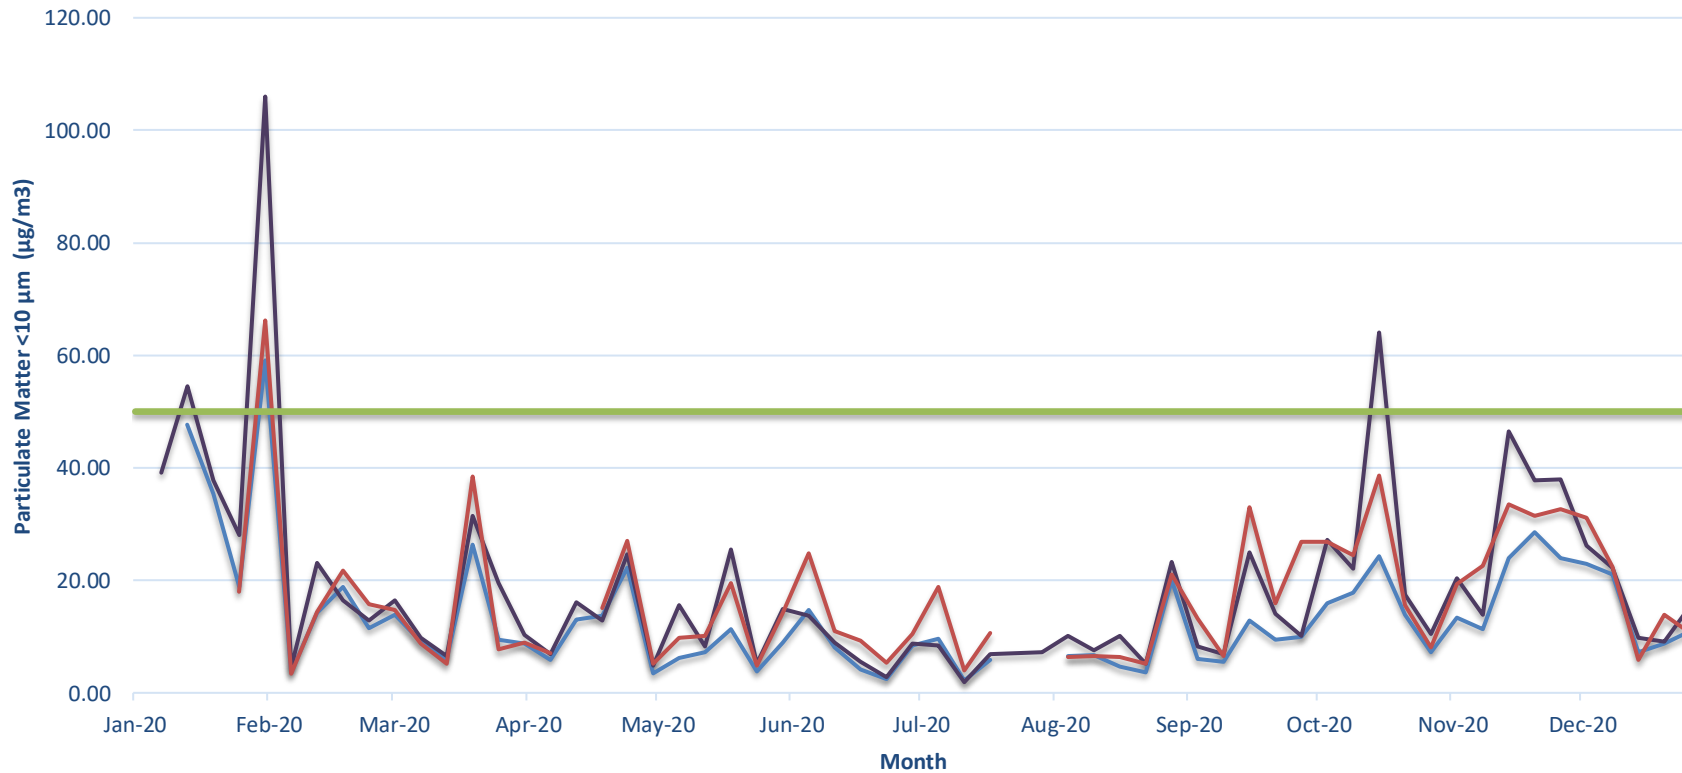


Notes:

1. Limit doesn't apply for extraordinary events such as bushfires, prescribed burning, or dust storms.
2. Recorded PM10 dust levels above 50 µg/m³ recorded in January, February and November 2020 were caused by regional dust events - refer EPA PM10 dust graph on page 6 of this report.
3. Due to operator error, all results recorded on the 9th January 2020 were invalid.
4. Power outages prevented samples from being collected at HV1 and HV5 during July 2020.

— HV1 (Wollar) — HV4 (Robinsons) — HV5 (Araluen Road) — 24 hour PM10 limit (refer notes)

Figure 3. TEOM (PM10) Results - 12 Month Trend

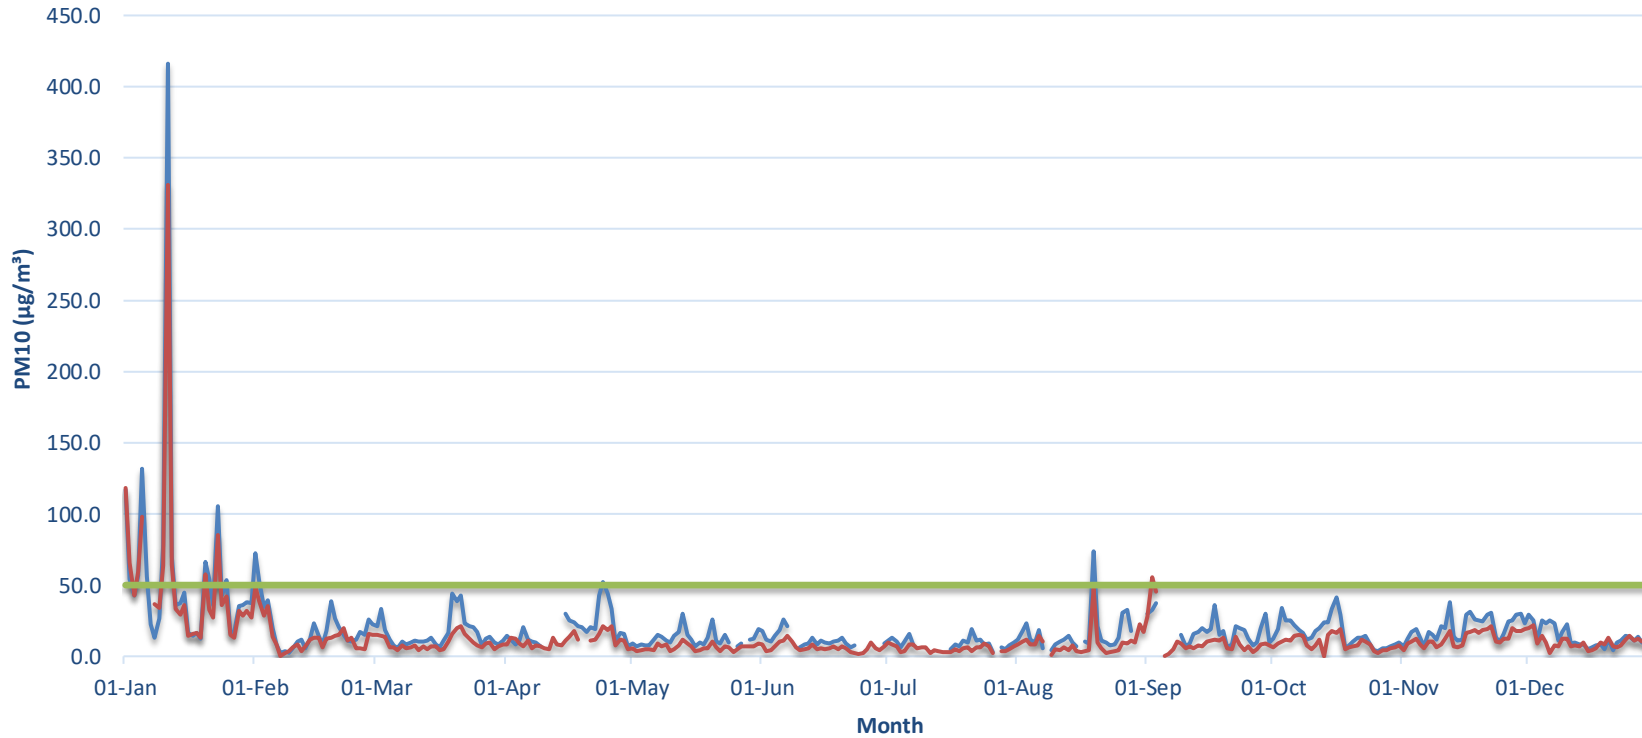


Notes:

1. Limit doesn't apply for extraordinary events such as bushfires, prescribed burning or dust storms
2. TEOM 4 (Araluen Rd) influenced by dust from Araluen Road generally during stable atmospheric conditions (i.e. temperature inversions)
3. Elevated PM10 dust levels recorded in January 2020 due to regional dust events and/or bushfire smoke.
4. The elevated PM10 dust levels recorded at TEOM 4 in April 2020 was due to a temperature inversion trapping road dust and lack of rainfall.
5. Power outages during April, June, July and September 2020 resulted in periods of no data at TEOM 4. TEOM 3 underwent scheduled maintenance between April 19 and 20 2020.
6. PM10 data recorded at TEOM 3 between 28 June and 31 July 2020 is invalid due to instrument fault causing inaccurate results. The data is unable to be corrected or adjusted due to the nature of the failure
7. The elevated dust levels recorded on 19 August 2020 align with the regional dust event recorded by the Department of Planning, Industry and Environment, .

— TEOM 4 (Araluen Rd) — TEOM 3 (Wollar) — 24 hour PM10 Limit (refer Notes)

Figure 4. Daily PM10 Average Regional Results
Daily Maximums - PM10

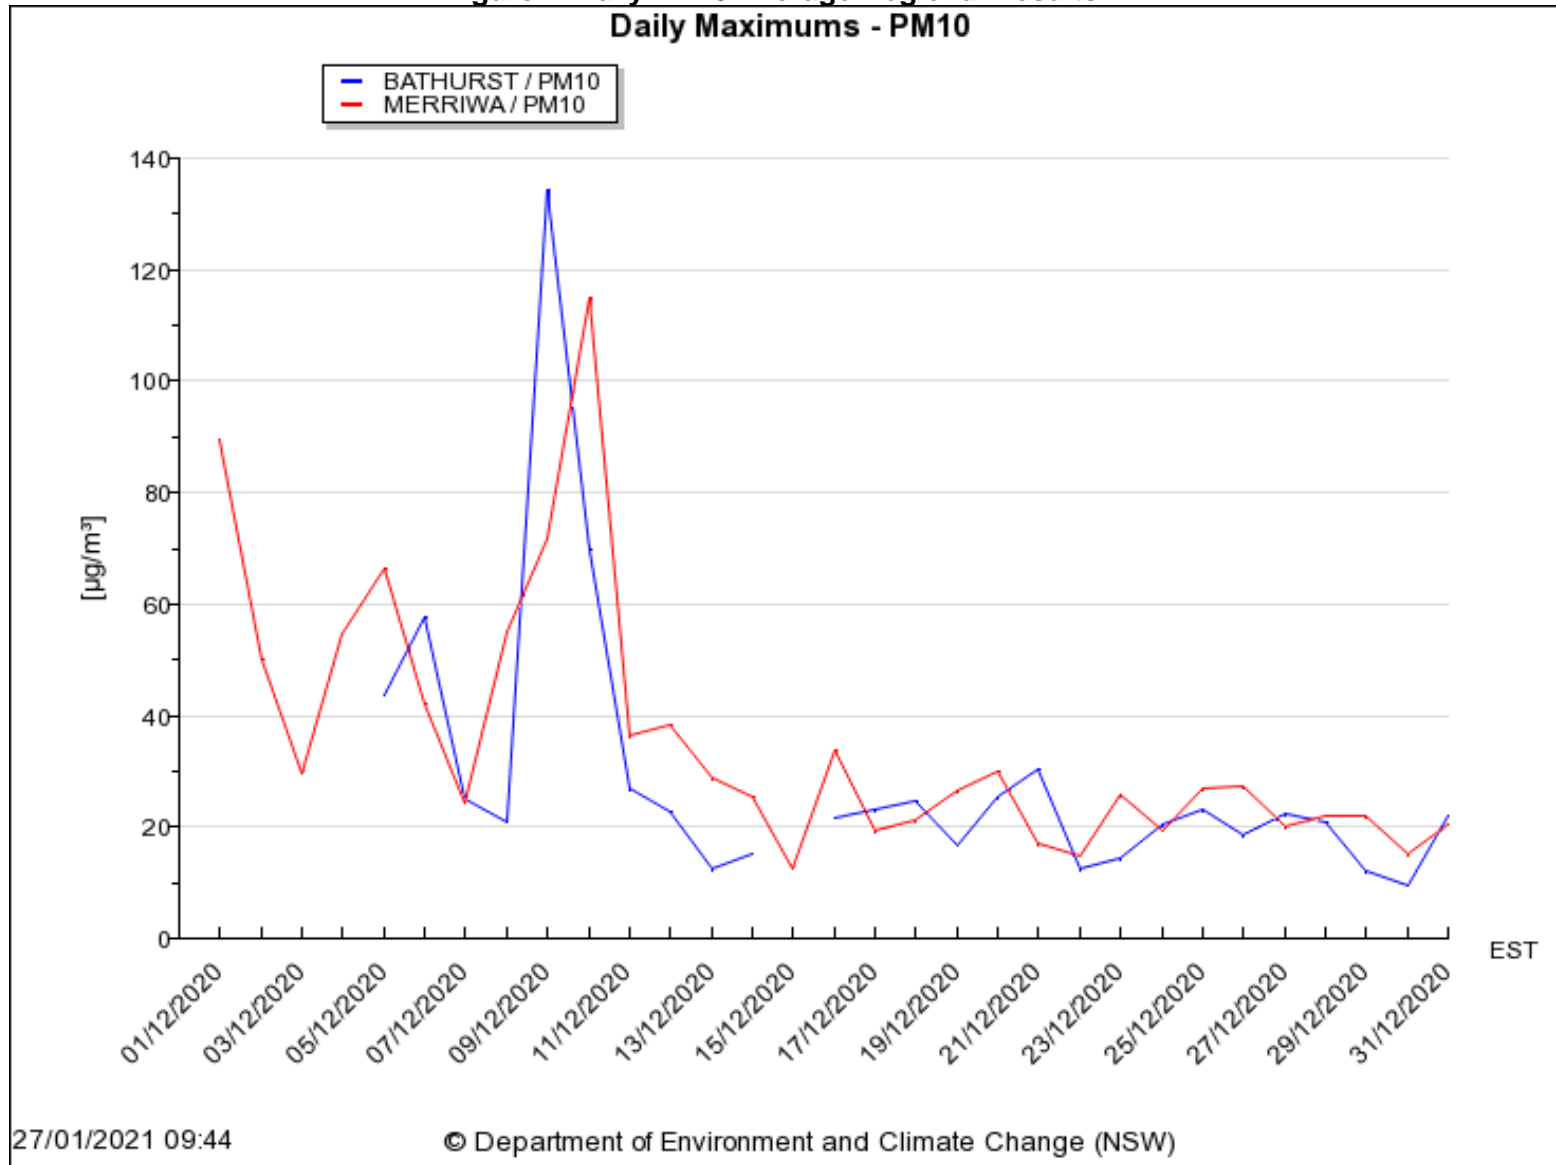

27/01/2021 09:44

© Department of Environment and Climate Change (NSW)

Surface Water Monitoring

Surface water runoff is isolated and diverted around disturbed areas through the construction of water diversion bunds. Runoff from disturbed areas is diverted into on-site water retention dams.

A Reverse Osmosis (RO) Plant treats all water from the retention dams before it is discharged to Wilpinjong Creek. The EPL specifies limits for the quantity and quality of water that may be discharged from the site.

Water Monitoring

EPL ID No.	Monitoring Point ID.	Pollutant	Unit of Measure	Monitoring Frequency required by EPL	No. of times measured during month	Min. Value	Max. Value	Mean Value	Measurement	Limit	Exceed* (yes/no)	Date Last Sampled	Date Reported
24	RO Plant Discharge	Conductivity	microSiemens per centimetre (uS/cm)	Continuous during discharge	100%	375	396	386		500	No		
		Oil and Grease	milligrams per litre (mg/L)	Weekly during any discharge	2	<5	<5	<5		10.0	No	29-Dec-2020	27-Jan-2021
		pH	pH Unit	Continuous during discharge	100%	7.1	7.2	7.2		≥6.5≤8.5	No		
		Total Suspended Solids	milligrams per litre (mg/L)	Weekly during any discharge	2	<1	<1	<1		50	No	29-Dec-2020	27-Jan-2021
		Volume discharged	megalitres per day	Continuous during discharge	100%	0.358	2.106	0.571		15.0	No		

Note: The RO Plant resumed operation on the 24th December 2020.

Noise Monitoring

Environmental noise monitoring (“monitoring”) is carried out monthly.

The purpose of the monitoring is to assess whether mining operations are consistent with the objectives of the EPL and the development consent conditions.

In terms of this monitoring, it is undertaken:

1. by an independent noise consultant;
2. during the night-time; and
3. at the sites shown in **Figure 7**.

On pages 10 and 11 of this report are the noise levels and findings from the consultant’s report.

Table 4.2: $L_{Aeq,15minute}$ GENERATED BY WCP AGAINST PROJECT SPECIFIC CRITERIA – DECEMBER 2020

Location	Start Date and Time	Wind Speed m/s ¹	Stability Class ¹	Criterion dB	Criterion Applies? ²	WCP $L_{Aeq,15min}$ dB ³	Exceedance ⁴
N6	10/12/2020 00:43	0.9	D	37	Yes	IA	Nil
N14	10/12/2020 00:15	1.1	E	35	Yes	IA	Nil
N15	09/12/2020 23:00	0.8	F	37	Yes	IA	Nil
N17	09/12/2020 22:27	1.4	F	38	Yes	<25	Nil
N19	09/12/2020 22:00	0.0	G	35	No	IA	NA
N20	09/12/2020 23:30	0.7	E	35	Yes	IA	Nil

Notes:

1. Wind speed is sourced from the WCP weather station, stability class is determined based on WCP inversion tower data;
2. Noise emission limits apply for all meteorological conditions, except for the following: wind speeds greater than 3 m/s above ground level; or stability category F temperature inversions and wind speeds greater than 2 m/s at 10m above ground level; or stability category G temperature inversion conditions;
3. Site-only $L_{Aeq,15minute}$ attributed to WCP, including modifying factors if applicable; and
4. NA in exceedance column means criterion was not applicable due to atmospheric conditions outside those specified in EPL.

Table 4.3: $L_{A1,1minute}$ GENERATED BY WCP AGAINST PROJECT SPECIFIC CRITERIA – DECEMBER 2020

Location	Start Date and Time	Wind Speed m/s ¹	Stability Class ¹	Criterion dB	Criterion Applies? ²	WCP $L_{A1,1min}$ dB ³	Exceedance ⁴
N6	10/12/2020 00:43	0.9	D	45	Yes	IA	Nil
N14	10/12/2020 00:15	1.1	E	45	Yes	IA	Nil
N15	09/12/2020 23:00	0.8	F	45	Yes	IA	Nil
N17	09/12/2020 22:27	1.4	F	45	Yes	28	Nil
N19	09/12/2020 22:00	0.0	G	45	No	IA	NA
N20	09/12/2020 23:30	0.7	E	45	Yes	IA	Nil

Notes:

1. Wind speed is sourced from the WCP weather station, stability class is determined based on WCP inversion tower data;
2. Noise emission limits apply for all meteorological conditions, except for the following: wind speeds greater than 3 m/s above ground level; or stability category F temperature inversions and wind speeds greater than 2 m/s at 10m above ground level; or stability category G temperature inversion conditions;
3. Site-only $L_{A1,1minute}$ attributed to WCP; and
4. NA in exceedance column means criterion was not applicable due to atmospheric conditions outside those specified in EPL.

6 SUMMARY

Global Acoustics was engaged by Wilpinjong Coal Pty Ltd to conduct a monthly noise survey of operations at WCP, an open cut coal mine located approximately 40 kilometres north east of Mudgee. The purpose of the attended noise monitoring survey is to quantify and describe the acoustic environment around the site and compare results with specified limits.

Attended environmental noise monitoring described in this report was undertaken during the night period of 9/10 December 2020 at six monitoring locations.

Noise levels from WCP complied with relevant noise limits at all monitoring locations during the December 2020 monitoring. Criteria may not always be applicable due to meteorological conditions at the time of monitoring.

Global Acoustics Pty Ltd

Wilpinjong Coal received the report from Global Acoustics Pty Ltd on 31st December 2020.

Blasting

Monitoring is carried out near sensitive locations during blasting activities to determine the vibration in the air (overpressure) and earth (ground vibration). A summary of the results of this monitoring, and the limits specified in the EPL, are shown in **Tables 3 and 4**. **Figures 7 & 8** shows the actual overpressure and vibration levels recorded during the month.

Table 3 – Overpressure Monitoring Results

Location	Month	Number of Blasts	Minimum overpressure (dB(L))	Maximum overpressure (dB(L))	Mean overpressure (dB(L))	EPL overpressure Limits (dB(L))	Exceedance (yes/no)
Approx. 50m west of the Wollar Public School	December	14	74.1	109.1	94.5	115dB (95% blasts) 120dB (100% blasts)	no

Table 4 – Vibration Monitoring Results

Location	Month	Number of Blasts	Minimum vibration (mm/sec)	Maximum vibration (mm/sec)	Mean vibration (mm/sec)	EPL vibration Limits (mm/sec)	Exceedance (yes/no)
Approx. 50m west of the Wollar Public School	December	14	0.03	2.57	0.30	5 mm/s (95% blasts) 10 mm/s (100% blasts)	no

Figure 7. Overpressure (dBL) recorded during Month


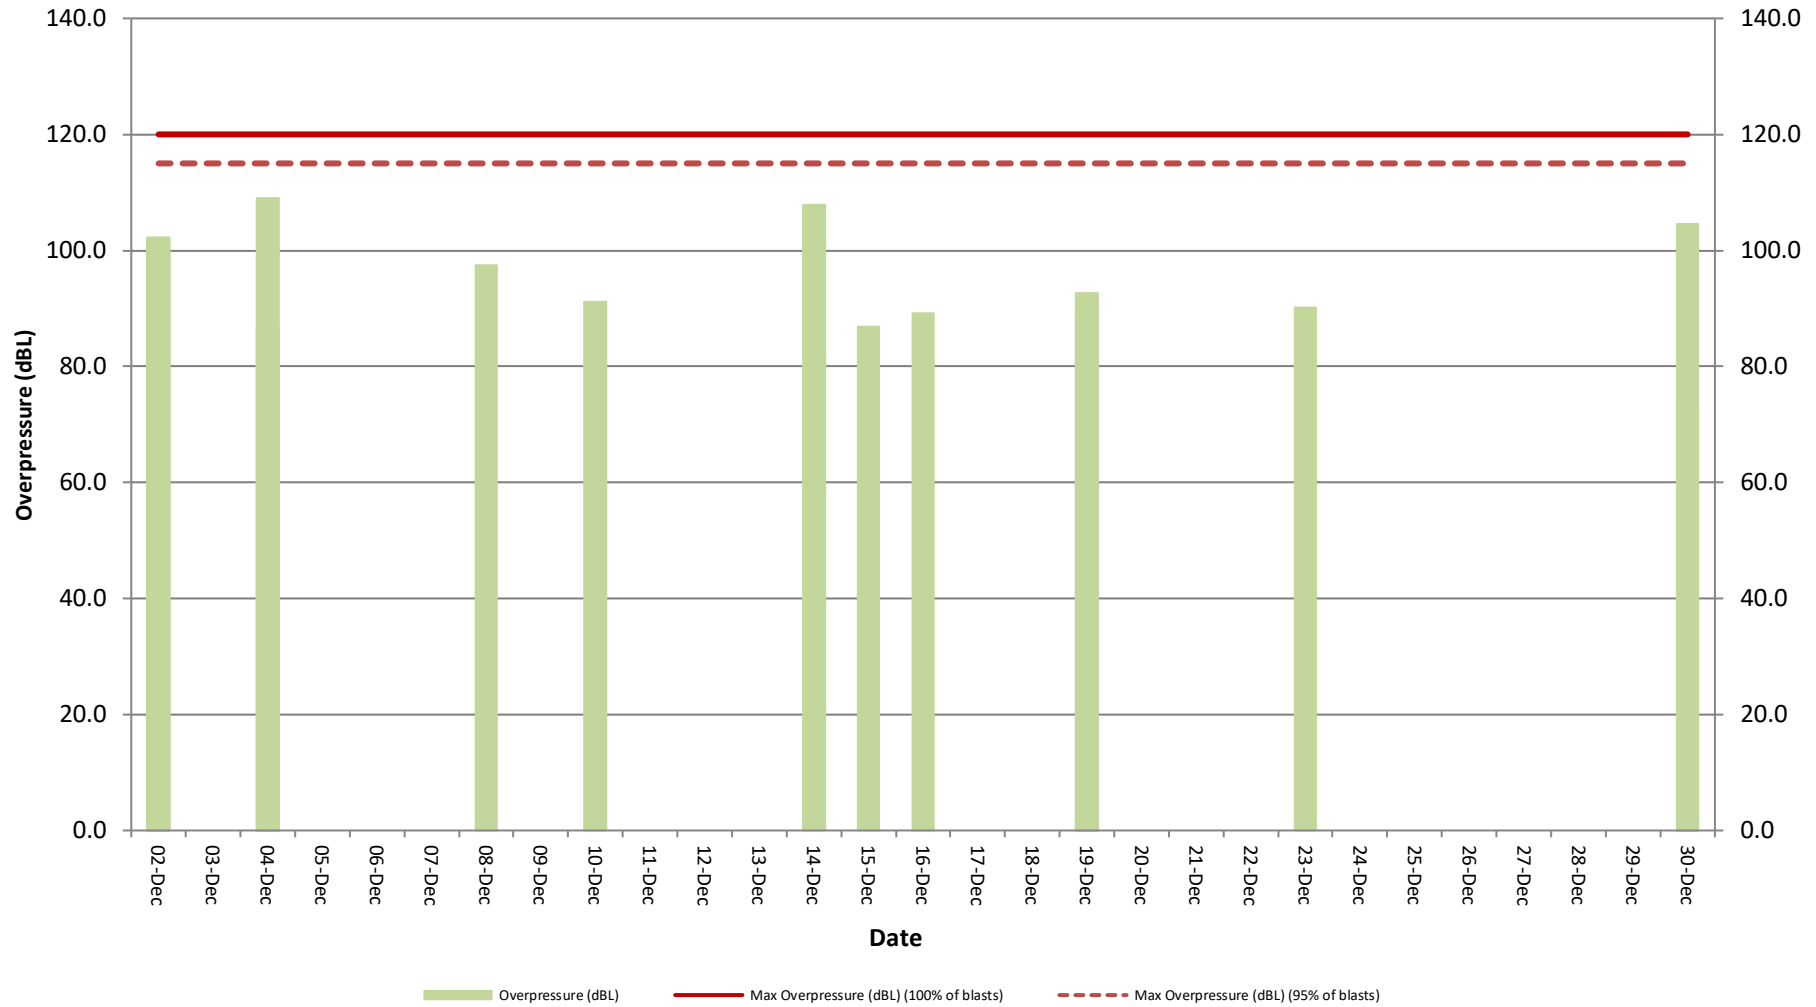


Figure 8. Vibration (mm/s) recorded during Month

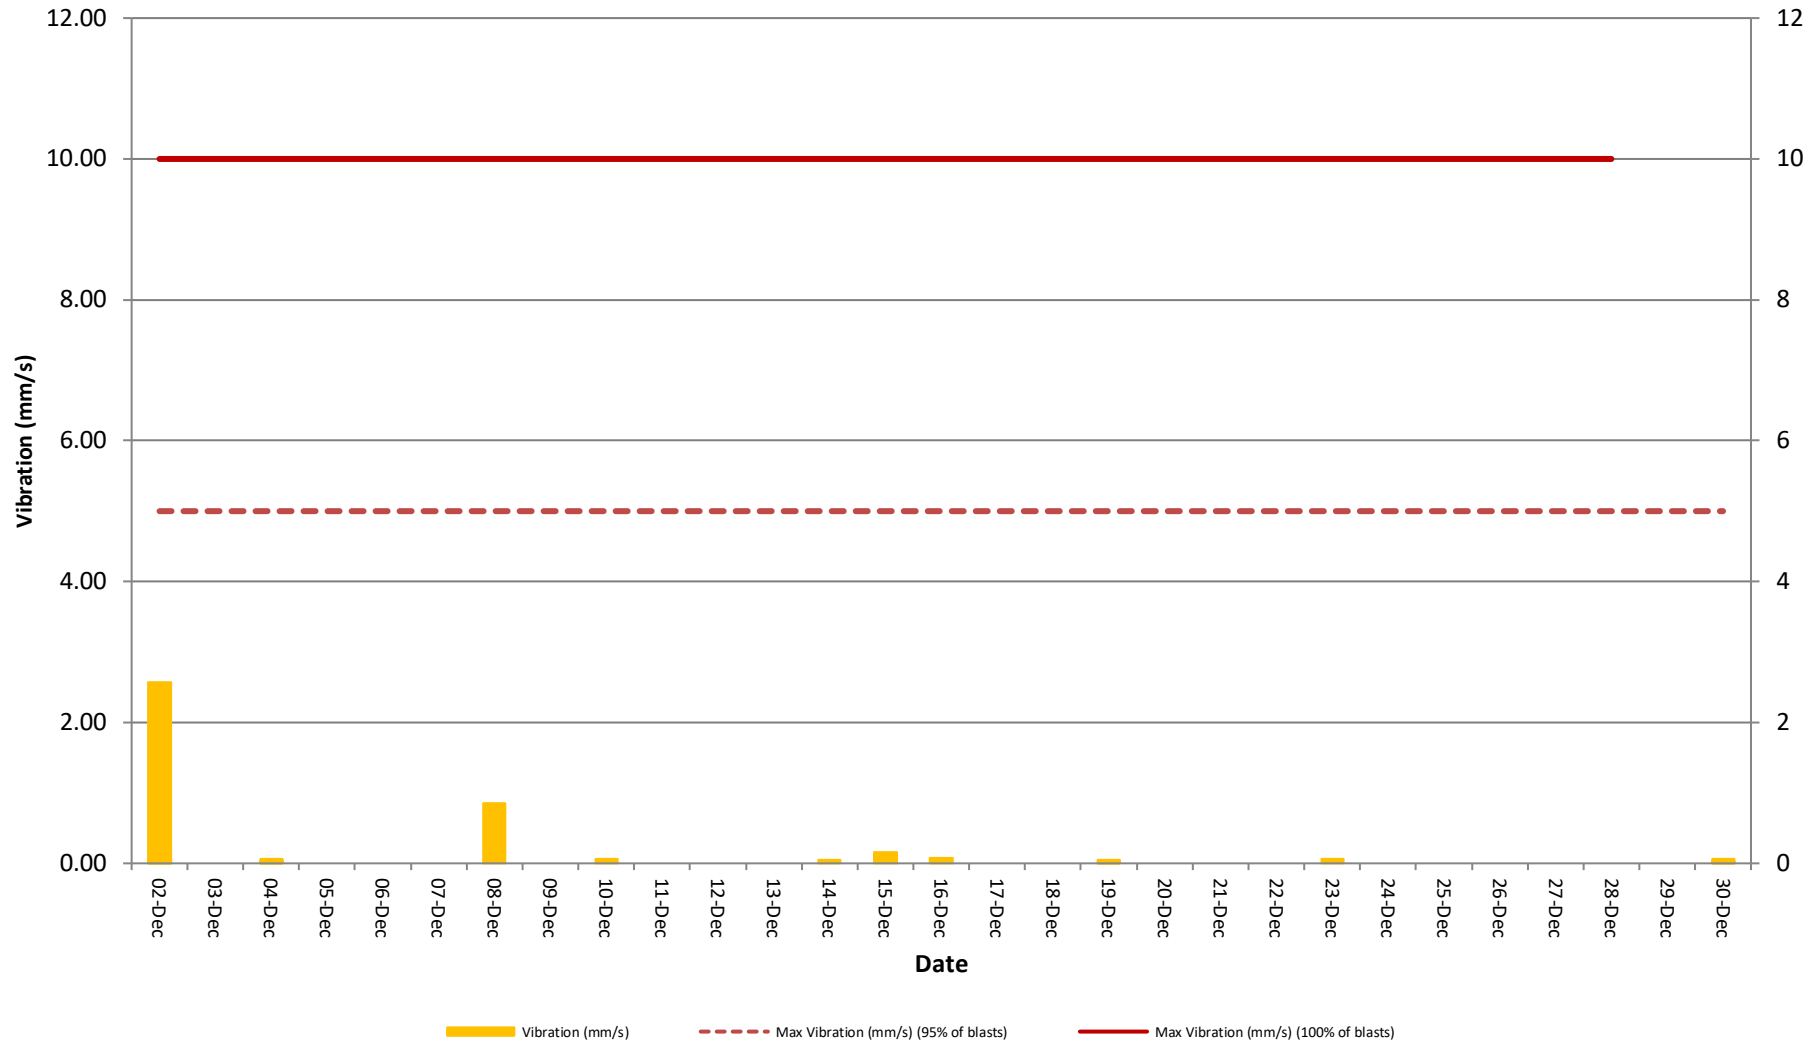

Weather Monitoring

Continuous weather monitoring occurs onsite at the location shown on Figures 5 and 6 (**Meteorological Station**). The Meteorological Station continuously monitors for: rainfall; relative humidity; temperature (i.e. at 2m, 10m & 60m), barometric pressure, wind speed, wind direction and temperature lapse rate.

The temperature lapse rate is a measure of stable atmospheric conditions and is determined by measuring air temperature at two elevations 58m apart (i.e. 2m and 60m from ground level) and extrapolating the temperature difference over 58m to determine the lapse rate per °C/100m.

Table 5 shows the meteorological data recorded during the month.

Table 5 – Monthly Meteorological Data

Date	Temperature (°C)									Humidity (%)			Prevailing Wind				Rain (mm)	Bar (kPa)	Lapse Rate (°C/100m)
	2m			10m			60m			Speed			Dir (Deg)						
	Avg	Min	Max	Avg	Min	Max	Avg	Min	Max	Avg	Min	Max		Avg	Min	Max	Max		
1/12/2020	26	15.7	40.7	25.7	15.9	40.2	25.5	15.6	39.3	58.5	19.4	84.3	0.1	0.1	9.4	65	2.4	1008.3	6.8
2/12/2020	23.7	18.9	29.8	23.4	18.3	28.8	23.4	18	28	73.3	53.8	94.6	2.5	0	6.4	69	0	1014.1	5.4
3/12/2020	21.3	17.6	25.6	20.9	17.2	24.8	20.3	16.8	24	71	57.4	81.5	3	0.2	6	73	0	1017.6	0.0
4/12/2020	25.4	16.9	34.1	25.4	17.2	33.6	25.4	18	32.7	52.2	10.7	93.7	2.4	0	7.2	257	0	1011.2	9.3
5/12/2020	19.6	12.6	25	19.7	13.7	24.6	20.3	16.2	24	71.2	49.6	92.8	0.5	0	6.6	86	28.2	1007.5	10.9
6/12/2020	22.3	18.2	27	22.1	19.3	26.4	21.6	18.9	25.2	54.8	24.5	92.9	4.7	0.7	8.4	265	0.8	1003.5	4.7
7/12/2020	20.6	12.5	26.9	20.6	13.4	26.3	20.5	14.6	25.3	43.2	21.7	79	3.4	0	7.6	264	0	1005.3	5.8
8/12/2020	18.1	12.1	23.4	17.6	12.2	22.3	17	11.9	21.3	39.9	22.1	67	3.2	0.3	5.3	224	0	1012	4.6
9/12/2020	19.3	9.3	28.3	19.4	9.6	27.5	19.3	10.6	27	49.6	20.8	89.2	0.5	0	3.9	0	0	1015.5	7.5
10/12/2020	21.9	12.1	31.5	21.7	12.8	30.3	21.5	13.6	29.4	52.3	18.7	86.9	1	0	6.6	81	0	1014.9	4.9
11/12/2020	17.7	15.6	20.5	17.2	15.5	19.8	16.6	15.1	18.9	60.9	50.3	63.8	5.8	3.5	7.4	86	0	1023.5	-0.7
12/12/2020	18.2	14.1	22.8	17.8	14.1	21.9	17.3	13.9	21	54.9	37.8	71.5	5.4	3	7.9	86	0	1024.2	-0.2
13/12/2020	20	15.7	25	19.5	15.6	24.2	18.9	15.3	23.2	56.2	39.4	74.6	5.7	3.1	7.7	84	0	1019.9	-0.5
14/12/2020	20.5	17.5	24.4	20	17.3	23.7	19.6	16.9	22.7	64.5	53.1	75.4	5.8	3.9	7.4	92	0	1015.5	-0.7
15/12/2020	21.9	17.8	26.1	21.6	17.9	25.6	21.1	17.3	24.9	74	57.8	89.8	4.1	1.8	6.5	88	0.2	1011	-0.5
16/12/2020	22.7	20.4	28.1	22.5	20.4	27.3	21.9	20.1	26.2	81.4	57.4	91.4	1.3	0.6	5.2	75	2.8	1008.1	0.2
17/12/2020	24	19.6	32.3	23.8	19.7	31.1	23.5	19.3	29.9	77.7	44.3	93.2	0.3	0	4.8	351	6.4	1005.1	4.4
18/12/2020	22.3	19.3	27.7	22.3	19.3	27.2	22.4	18.8	26.2	86.7	67.6	95.5	0.2	0	6.5	85	47.8	1007.2	3.2
19/12/2020	20.7	18.9	22.5	20.5	18.8	22.1	20.1	18.4	22.2	80.2	71	94.3	3.3	0.3	5.4	76	0	1012.4	0.9
20/12/2020	20.3	17.6	25.3	20.1	17.5	24.9	19.6	17	23.9	79.3	52.8	94.3	1.5	0.3	3.4	80	0.2	1010.6	-0.2
21/12/2020	17.7	16.9	18.9	17.7	16.8	19.2	17.3	16.2	19.1	91.3	84.9	95.4	1.3	0	3.5	83	41.4	1008.5	1.9
22/12/2020	19.8	16.9	23.7	19.6	17.1	23.2	19.2	16.6	22.6	67.7	38.1	96.1	4.1	0	8.1	257	1.2	1004.6	0.4
23/12/2020	19.9	12.3	26.5	19.6	12.9	25.6	19.2	13.5	25	52.7	37.1	75.2	0.2	0.5	4.9	24	0	1011.9	2.1
24/12/2020	21.2	15.6	28.2	21.1	15.9	27.5	21	15.8	27	60.3	34	80.8	0.1	0	3.5	28	0	1013.4	5.4
25/12/2020	20.2	13.5	26.1	20.1	14.4	25.1	20	15.3	24.3	68.8	45	92.6	2.7	0	5.8	70	0	1014.5	4.7
26/12/2020	20.4	17.2	26.1	20.2	17.2	25.5	19.7	16.8	24.9	70.6	51.8	84	3	0.9	5.7	85	2.8	1014.9	0.4
27/12/2020	24	16	31.3	23.9	16.4	30.3	23.6	16.5	29.6	63.4	35.7	94.5	1.3	0	5.3	301	0	1009.5	5.3
28/12/2020	22.7	17.7	30.7	22.7	17.6	29.8	22.6	17.2	28.6	67.9	43.3	93	1.5	0	6.8	303	21	1007.8	7.0
29/12/2020	19.5	16.3	23.1	19.2	16.5	22.4	18.8	16.4	21.8	82.6	65.6	94.3	2.3	0.1	4.3	79	6.4	1011.4	1.4
30/12/2020	20.9	16.7	25.5	20.5	16.7	24.9	20	16.2	24.2	72.6	54.9	90.2	3.6	1.3	6.8	83	0	1014.3	0.0
31/12/2020	21.4	19.2	25.4	21	19	24.7	20.4	18.6	23.8	71.7	58.2	80.5	4.2	2.4	6.8	77	0	1015.6	-0.9

Figure 6 – Air (Dust) Monitoring Locations

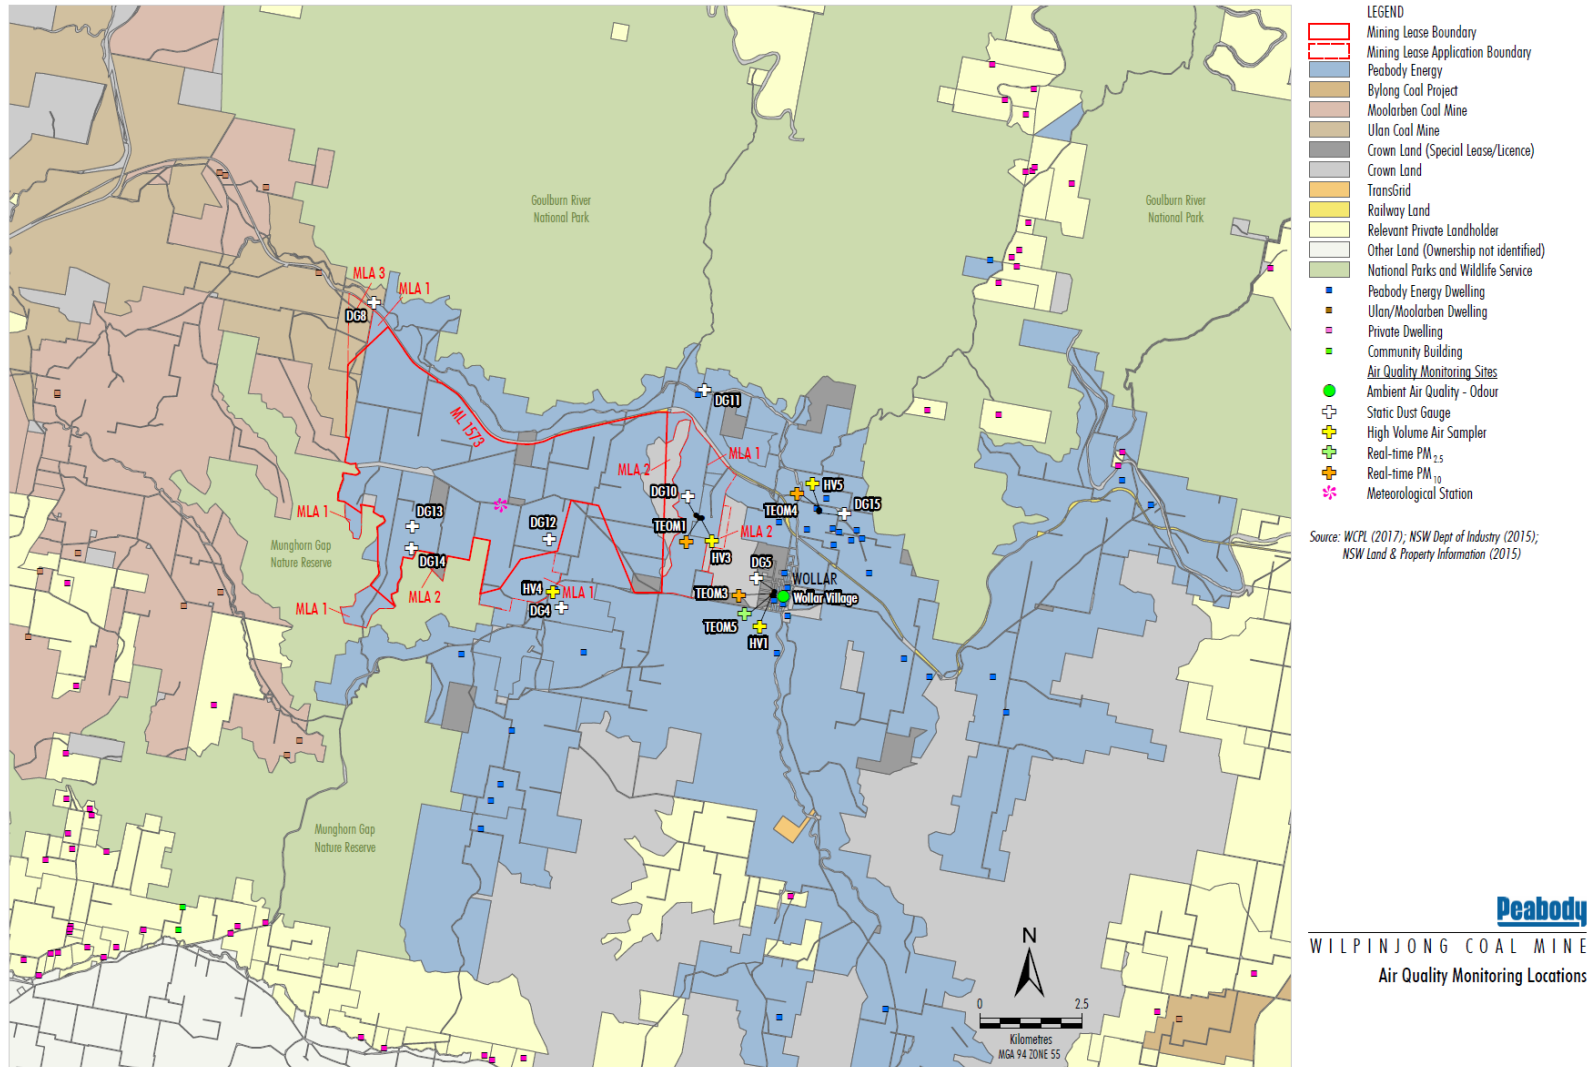


Figure 7 – Attended Noise Monitoring Locations

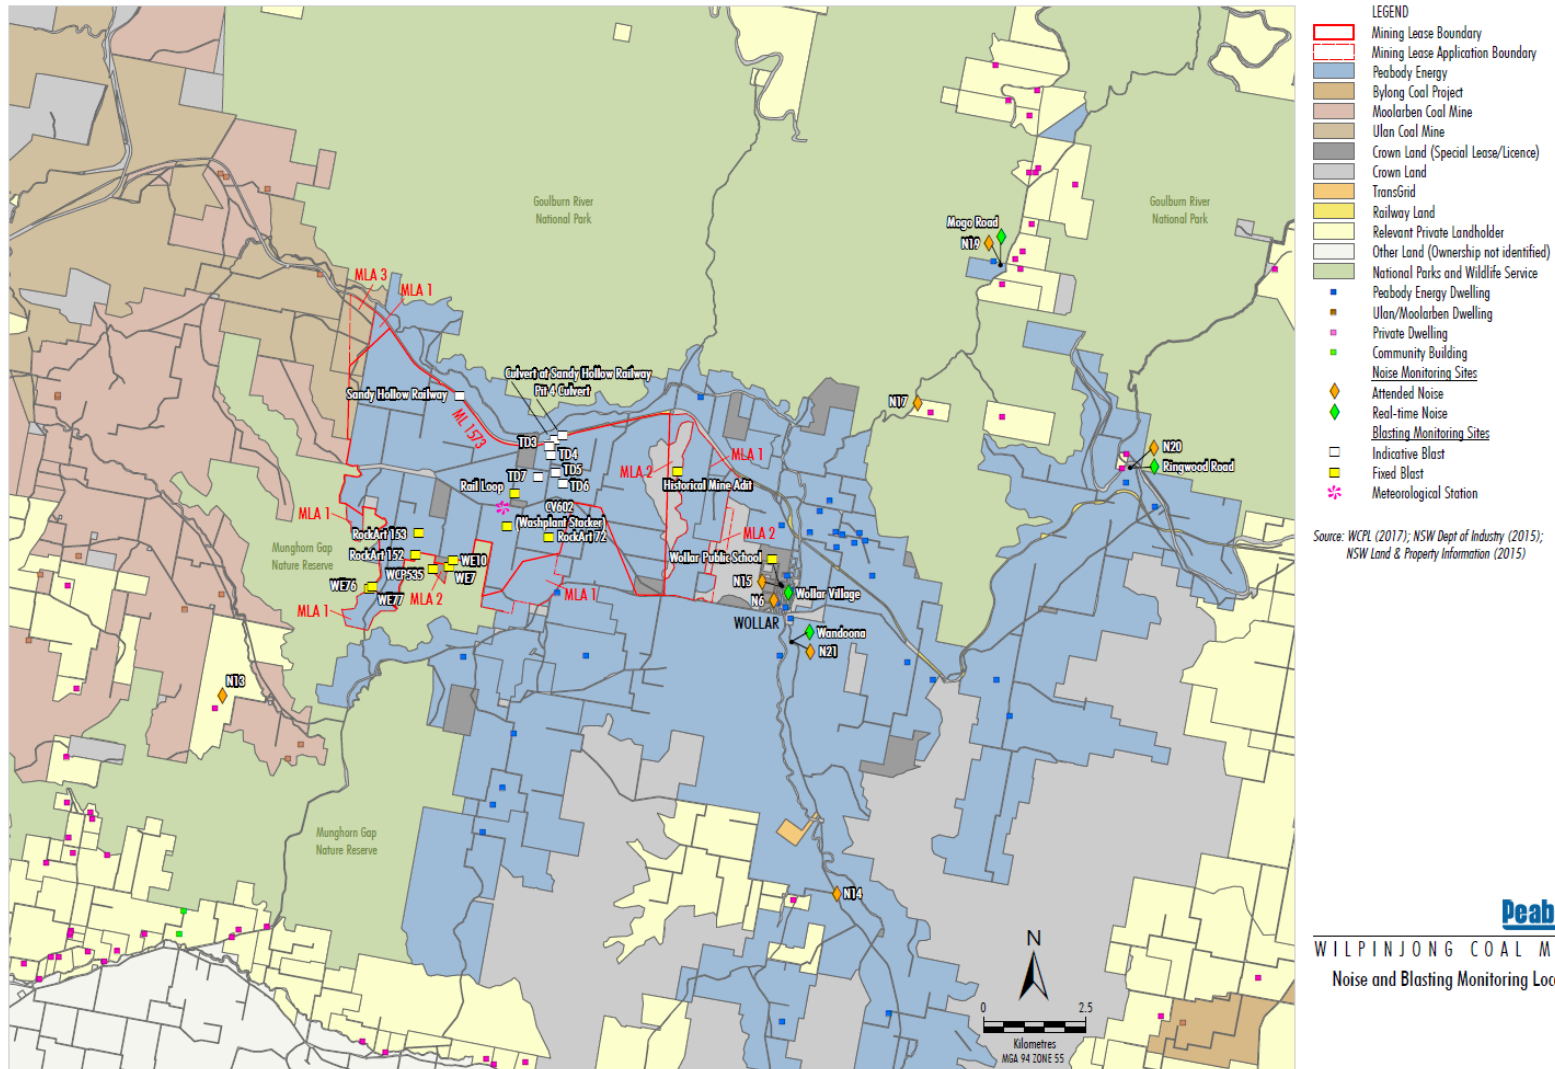


Figure 8 – Wollar Village Environmental Monitoring Sites



- LEGEND**
- Peabody Energy
 - Crown Land (Special Lease/Licence)
 - Crown Land
 - Railway Land
 - Relevant Private Landholder
 - 1 Landholder Reference Number
 - Peabody Energy Dwelling
 - Community Building
 - Private Dwelling
 - # Special Lease/Licence Holder

- Noise Monitoring Sites**
- Attended Noise
 - Real-time Noise
- Blasting Monitoring Sites**
- Fixed Blast
- Air Quality Monitoring Sites**
- Ambient Air Quality - Odour
 - Static Dust Gauge
 - High Volume Air Sampler
 - Real-time PM_{2.5}
 - Real-time PM₁₀

Source: WCPL (2017); NSW Dept of Industry (2015); NSW Land & Property Information (2016)

Peabody
 WILPINJONG COAL MINE
 Wollar Environmental Monitoring Sites